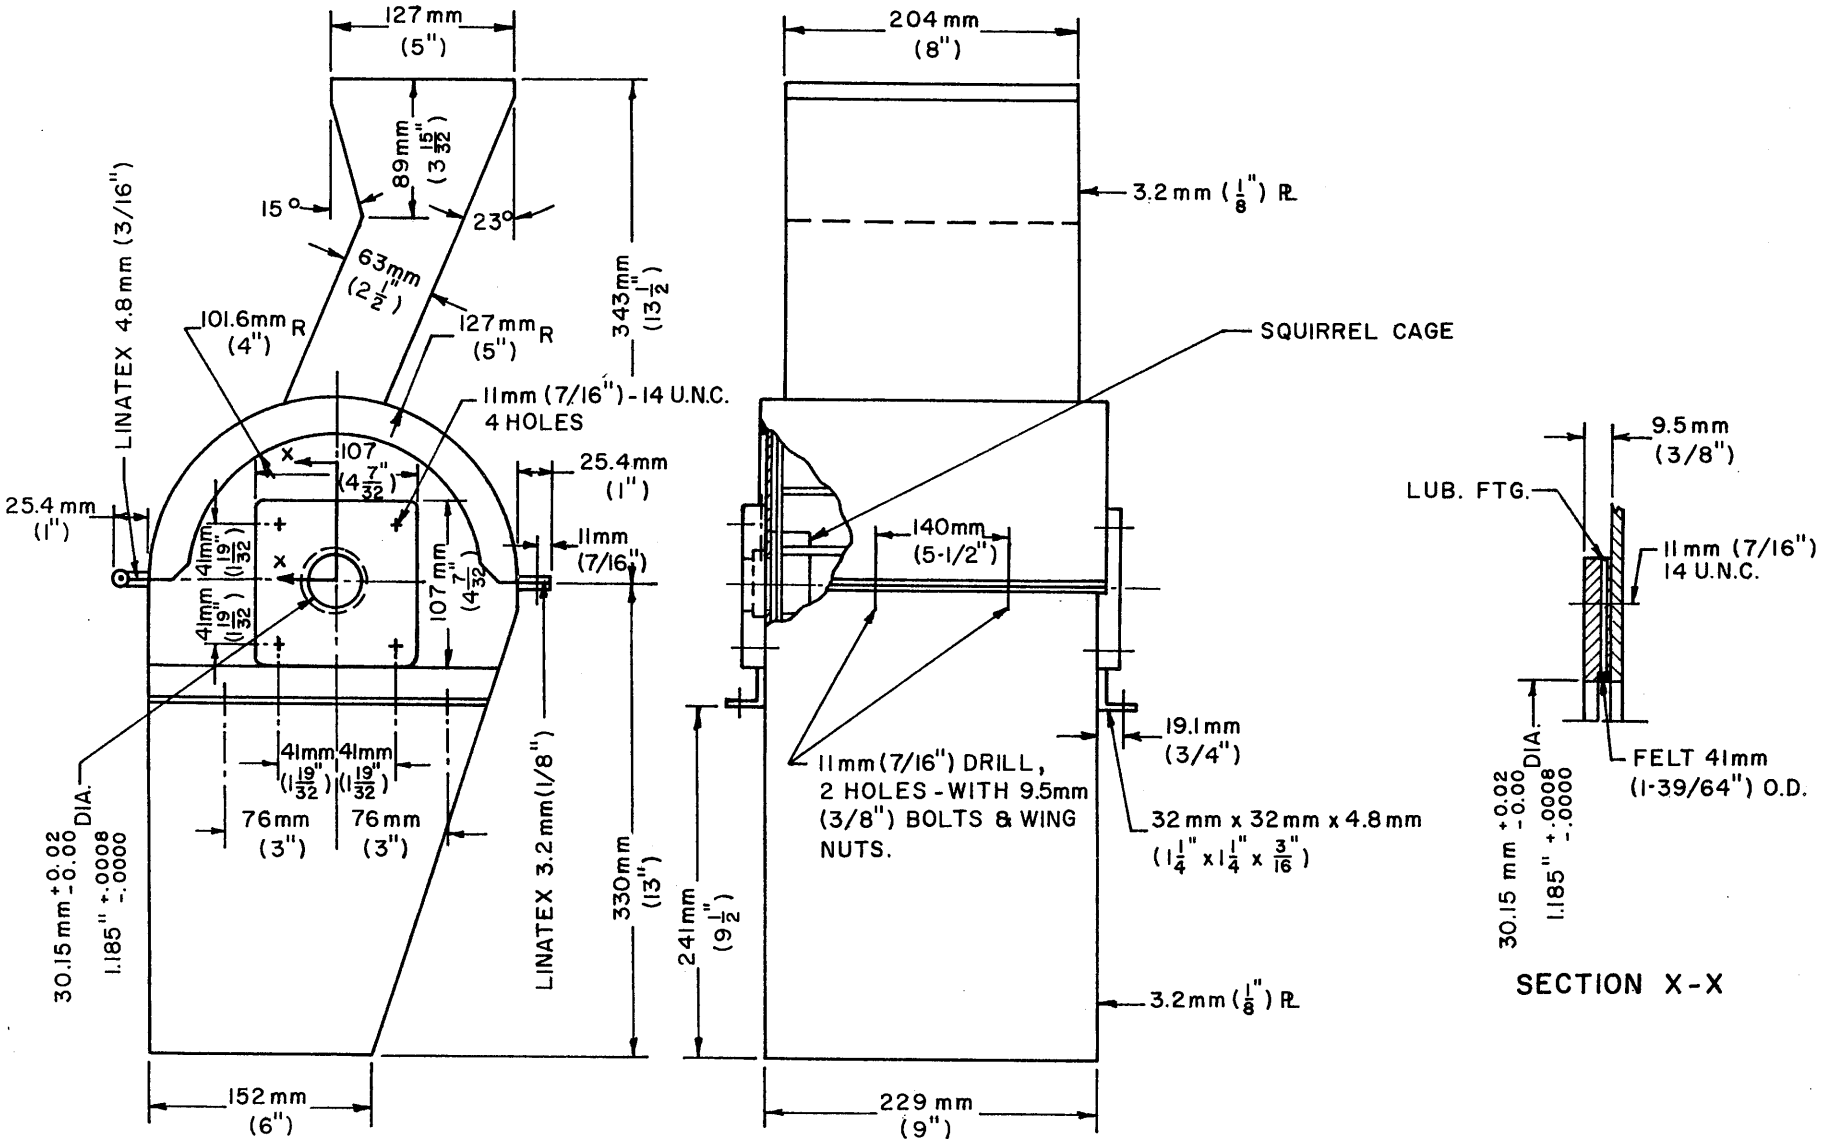

CONDITIONER HOUSING WITH HINGED COVER & INLET HOPPER

Fig. 2a Conditioner Details

© ASTM International
100 Barr Harbor Drive, PO Box C700
West Conshohocken, PA 19428-2959
ASTM Designation: **D2590/D2590M**
ASTM Stock Number: **ADJD2590-E-PDF**
2021